

WISE SoE data request 2007 - Step 3

EIONET-Water: Groundwater

Belgium

Aggregated data

Graphical presentation of possible outliers

Following graphical representations of time series were generated from data in tables, which are uploaded at Eionet Water library on EEA CIRCA on same place as this document. The tables contains list of records which responsible ETC-WTR data manager detected as outlying using documented rules and methods.

Responsible national data managers or experts can use this document to help them decide whether detected values are errors or results of natural processes which are possible in respective area. Results of their decision (either corrected values or explanation) should be prepared and delivered according published guidelines or upon an agreement with responsible data manager of the ETC-WTR.

Time series graphs are ordered by determinand and by station ID in this order.

Determinand:


Ammonium

WaterbaseID:

BE_GW_BE102

Outlier values ([Year, ViolatedRule]: Mean):

[2005, 111]: 12.505

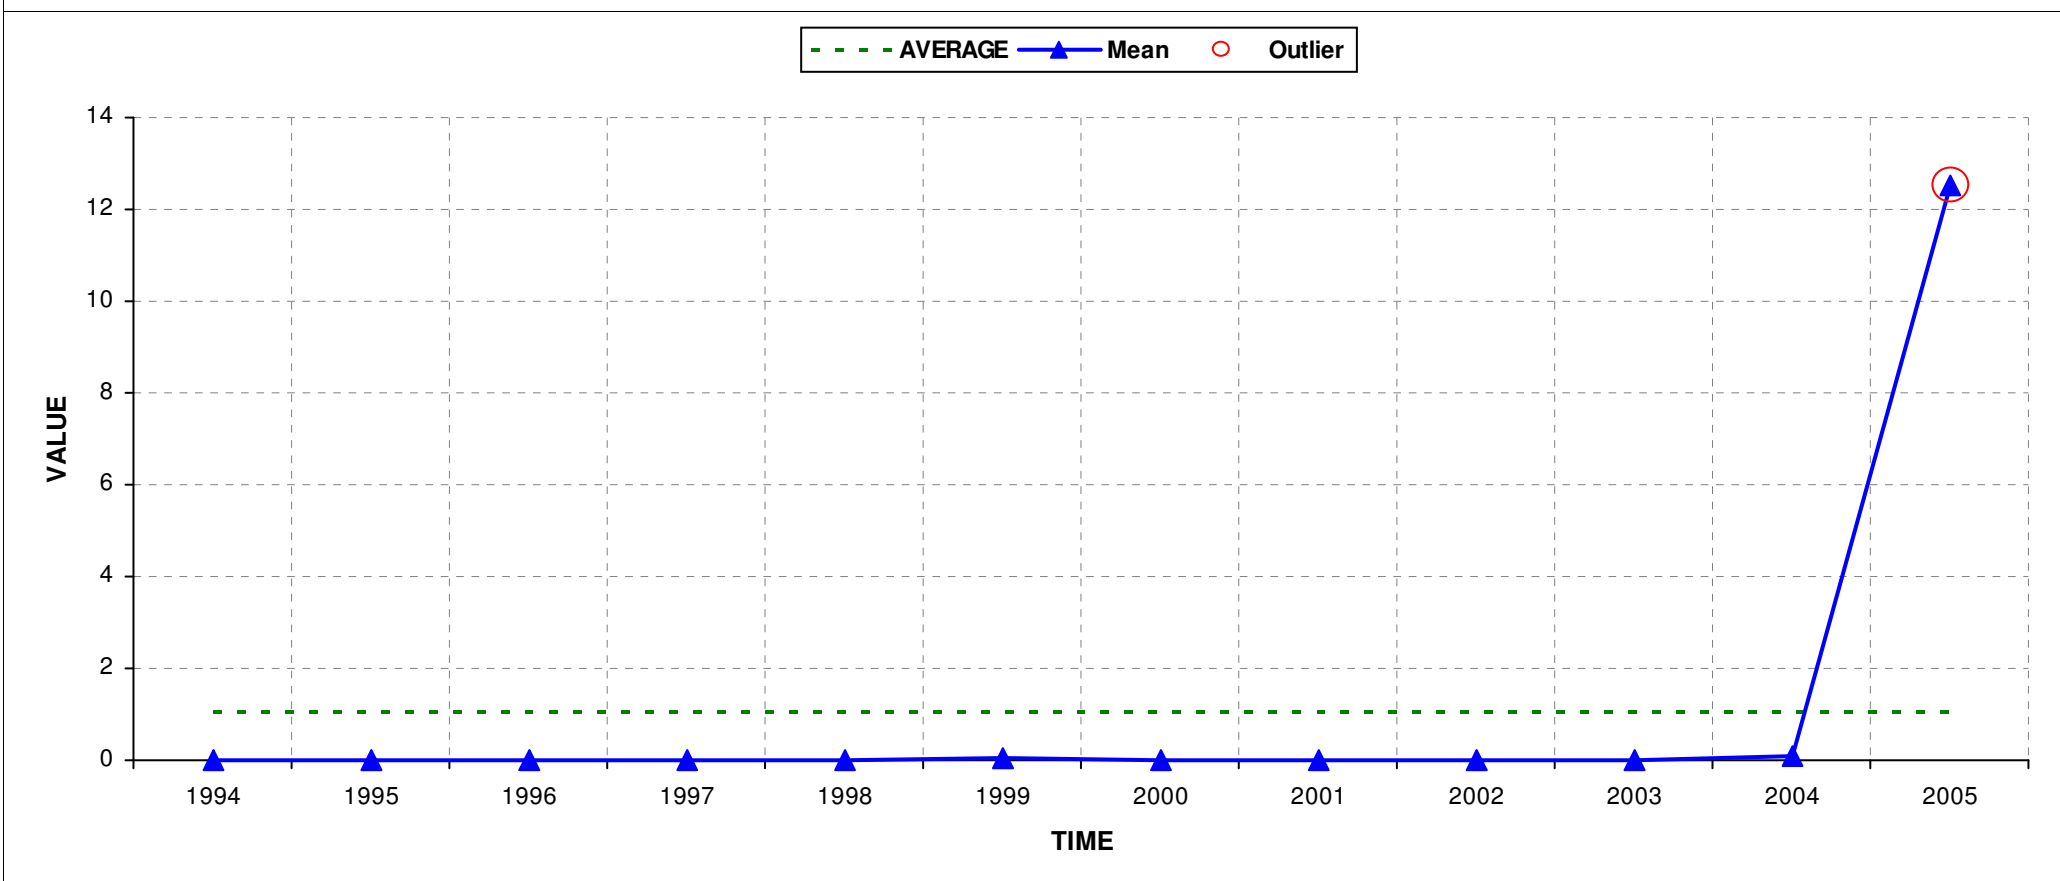

Determinand:


Nitrite

WaterbaseID:

BE_GW_BE102

Outlier values ([Year, ViolatedRule]: Mean):

[2005, 111]: 2.5025

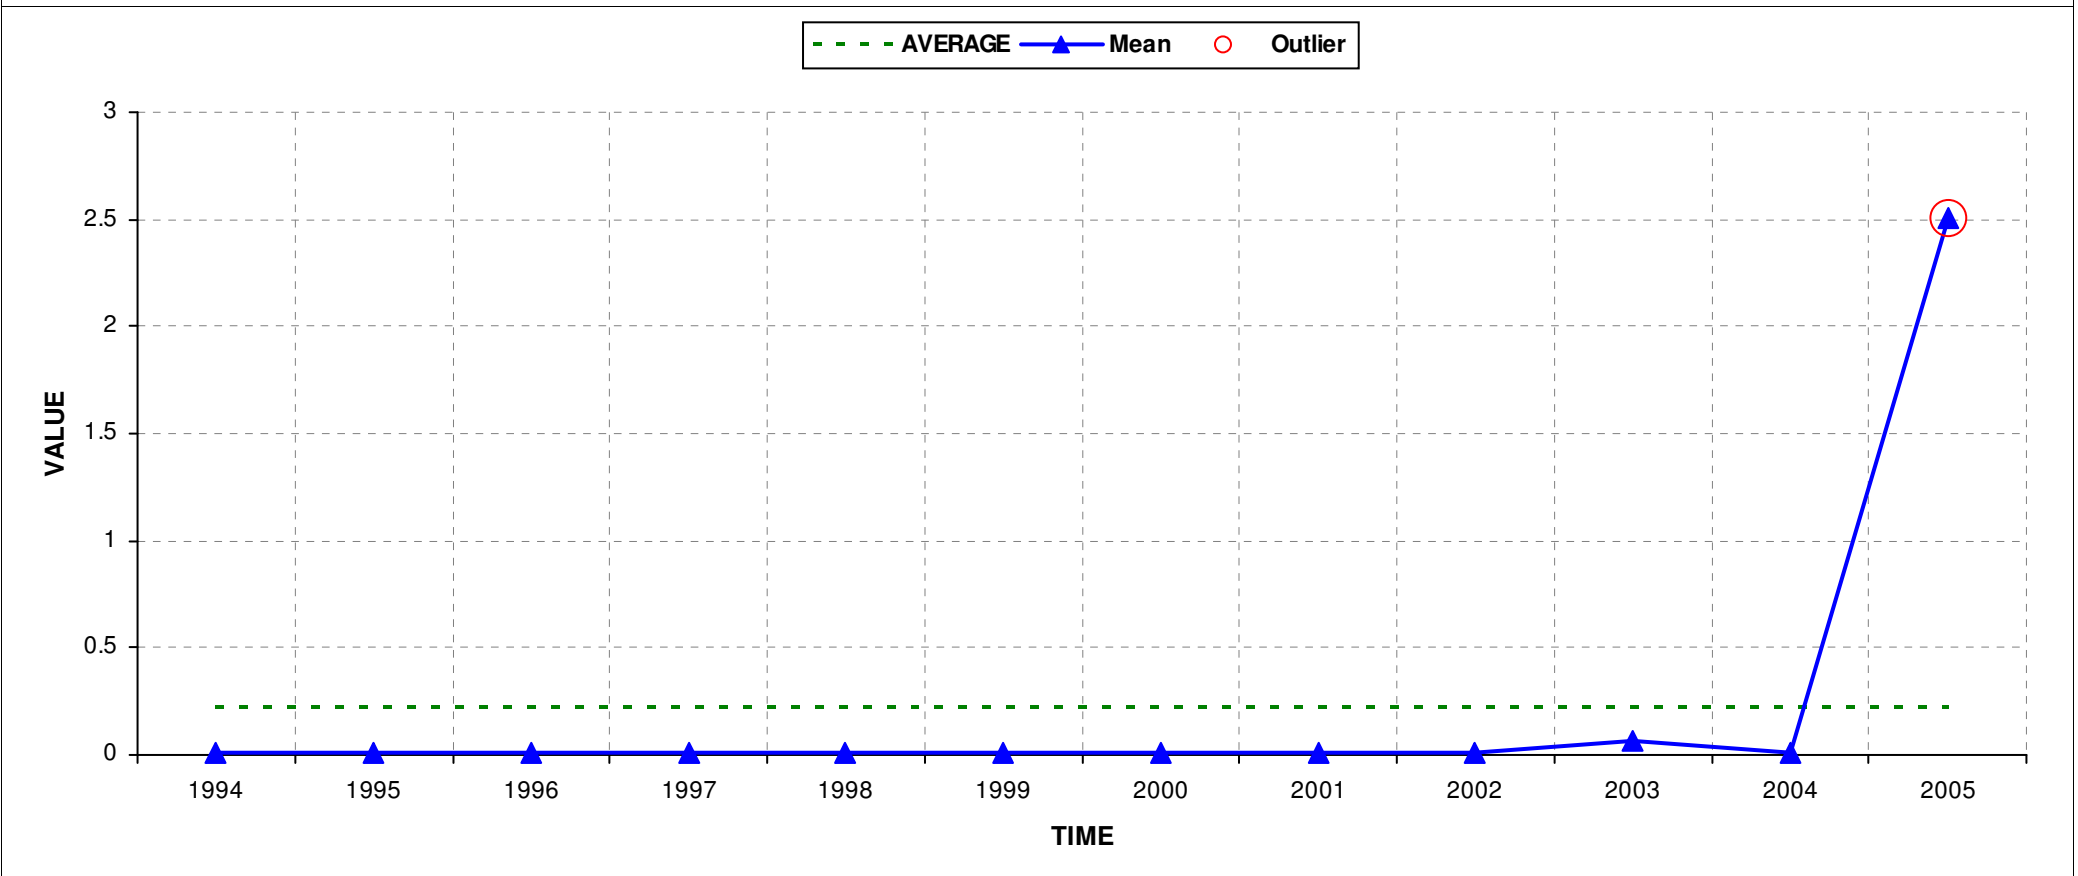

Determinand:

Nitrite

WaterbaseID:

BE_GW_BE112

Outlier values ([Year, ViolatedRule]: Mean):

[2004, 111]: 0.076

